

Fermax 2049



See Connection Diagrams
Below

IMPORTANT NOTE :

- 1) Before replacing the handset make note of the wires to each terminal on the existing unit (an easy way is to cut each core off leaving a piece of the insulation in place with colour visible) twist unused cores together (so you know they are not used, do not short them out).
- 2) Some older systems will have cable with one coloured core and a solid white core in this case mark each core with a marker or tape.
- 3) Some systems may have loop on wiring, you will have 2 cables into your handset (make sure any joins remain, as these may be serving other flats on the system).

Wiring Diagram

1 Button Panel and 4 intercommunicating handsets


FERMAX
Cod.94247 V 02/02

ALIMENTADOR CAMBIADOR MULTILINEAS / **MULTIWAY SWITCHER POWER SUPPLY**
Ref. 8805 / Ref. 8806 / Ref. 8807 / Ref. 8808



Este Alimentador Cambiador Multilíneas sólo funciona con teléfonos City TN-4 (Ref. 2049), TN-8 (Ref.2051) y Monitores VP-8 (Ref. 4132) .
This Multiway Switcher Power Supply only works with City TN-4 (Ref. 2049), TN-8 (Ref.2051) Telephones and VP8 (Ref. 4132) Monitors.

Instalación con Teléfonos TN-4 / Installation with TN-4 Telephones

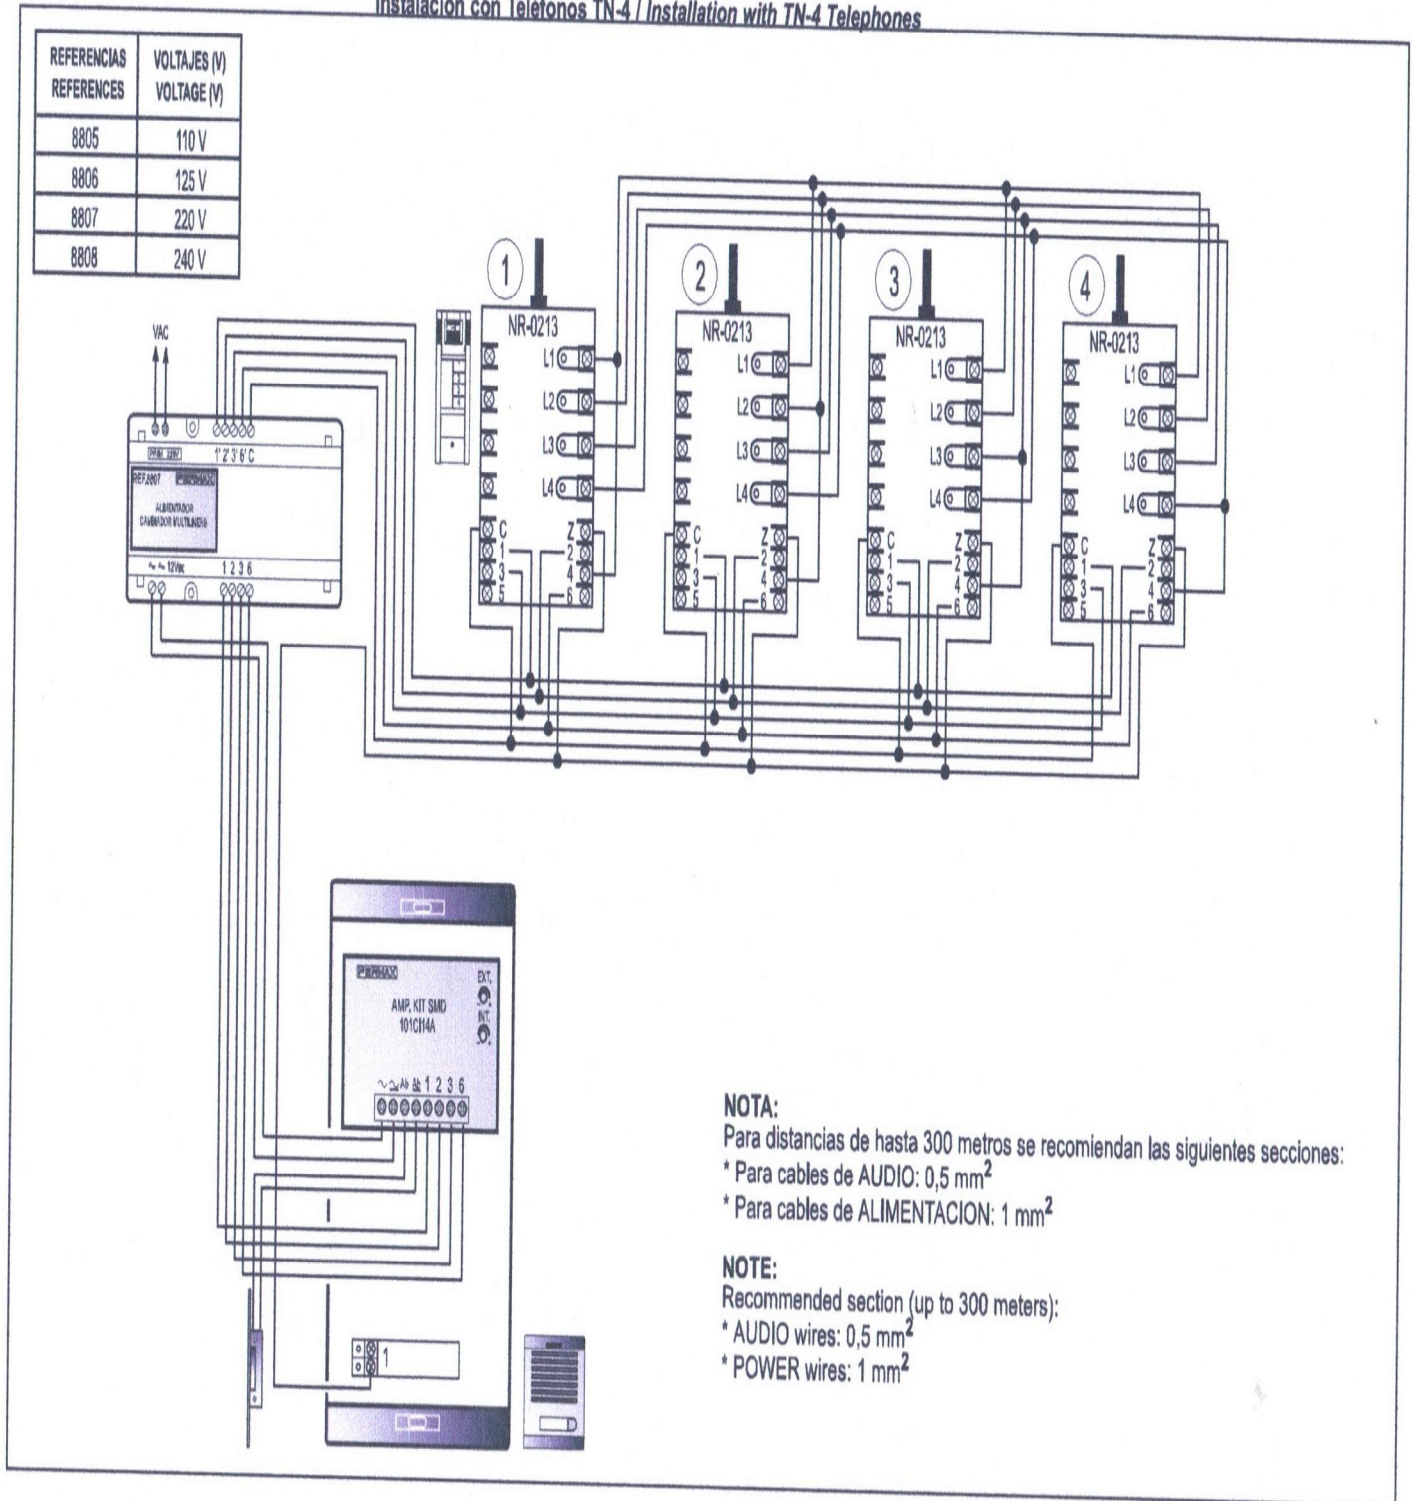

Wiring Diagram

1 Button Panel and 8 intercommunicating handsets

FERMAX
Cod.94247 V 02/02

ALIMENTADOR CAMBIADOR MULTILINEAS / MULTIWAY SWITCHER POWER SUPPLY
Ref. 8805 / Ref. 8806 / Ref. 8807 / Ref. 8808



Instalación con Teléfonos TN-8 / Installation with TN-8 Telephones

